




TSS Associates, Inc.



For further assistance, please contact
TSS Associates for Tech Support

518-621-4283

LEGEND:
 N/O = NORMALLY OPEN
 N/C = NORMALLY CLOSED

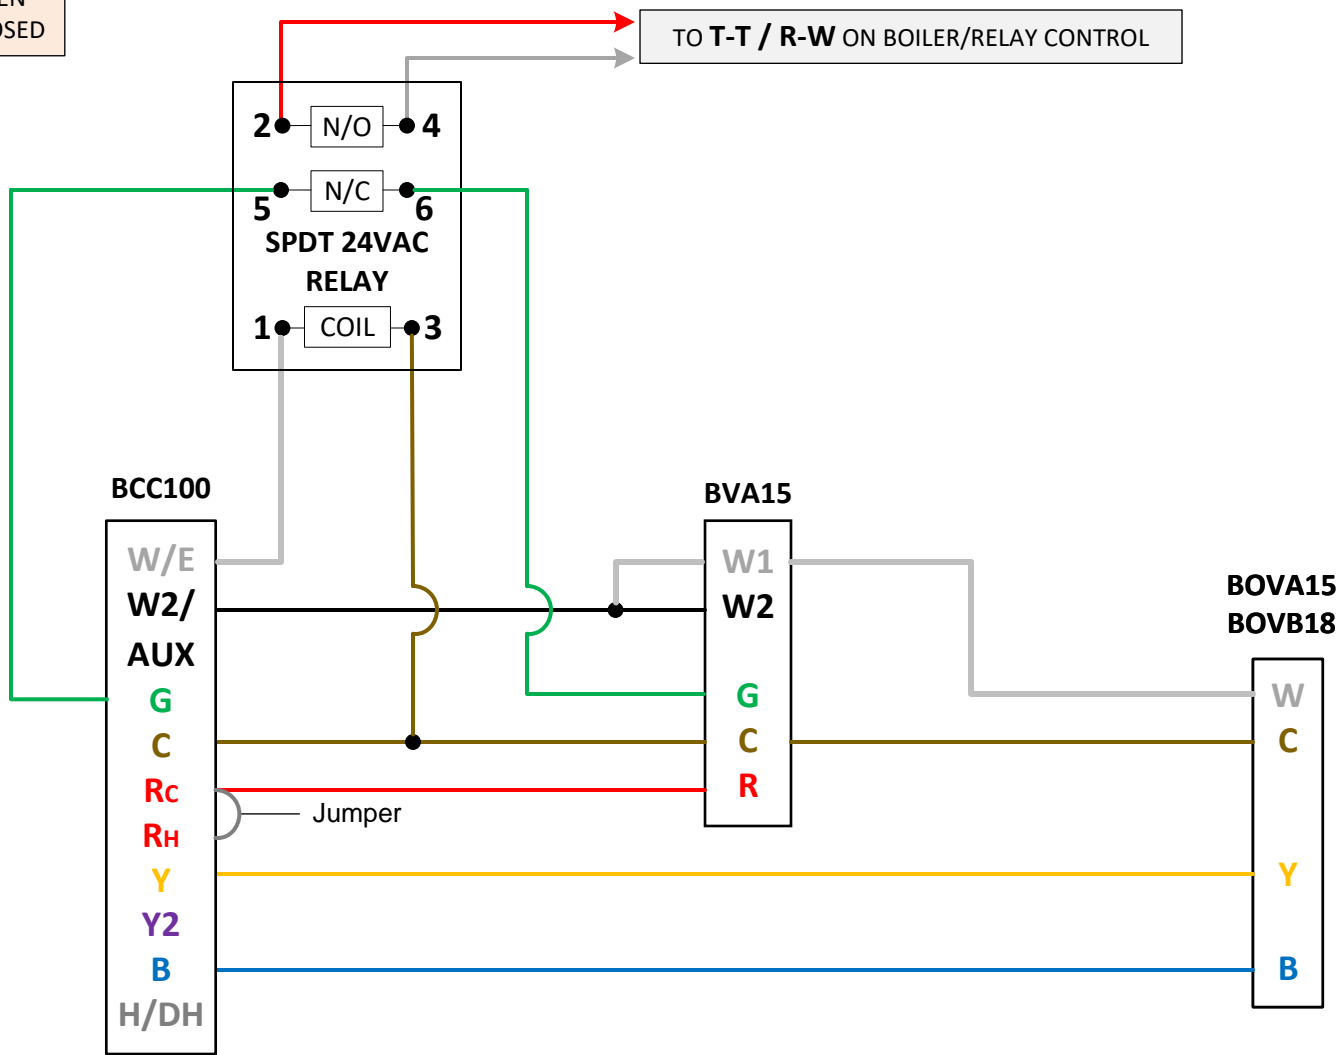


NOTES: >> Oil boiler is Emergency Heat, which locks out all compressor stages when selected
 >> Electric-strip is Auxiliary Heat
 >> Thermostat controls fan through 90-380 relay. When Emergency Heat is activated, fan signal is deactivated to AHU through relay
 >> Homeowner will have to manually activate Emergency Heat at the thermostat to activate oil boiler

TSS Associates, Inc.

DESCRIPTION	
IDS Light - Electric Auxiliary - Boiler Back-Up - BCC100	
DATE: 7/20/2022	PAGE: 1 of 2

PARAMETERS:

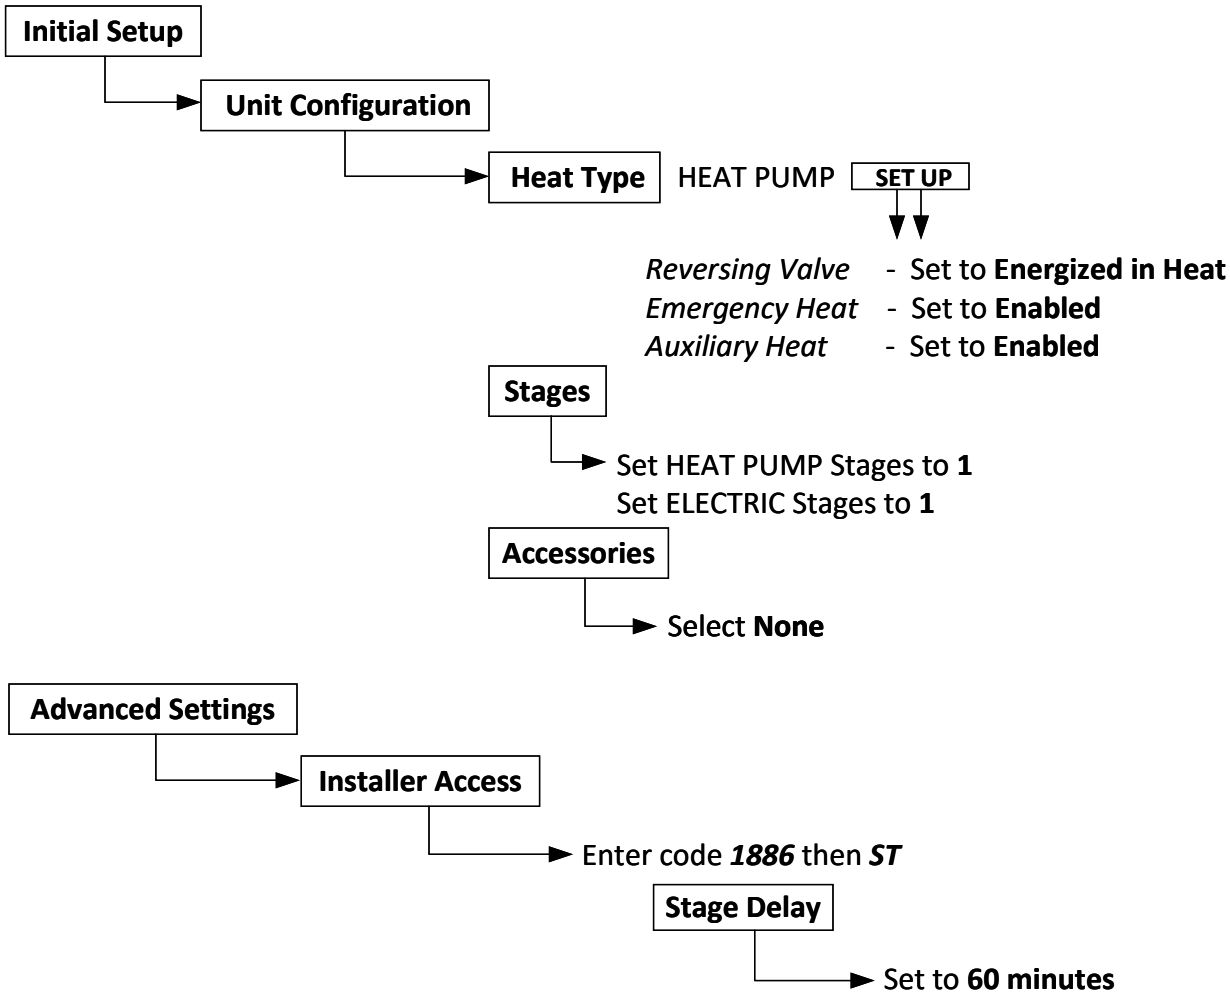

NOTES:

TSS Associates, Inc.

DESCRIPTION

IDS Light - Electric Auxiliary - Boiler Back-Up - BCC100

DATE: 6/23/2022

PAGE: 2 of 2