




TSS Associates, Inc.



For further assistance, please contact
TSS Associates for Tech Support


518-621-4283

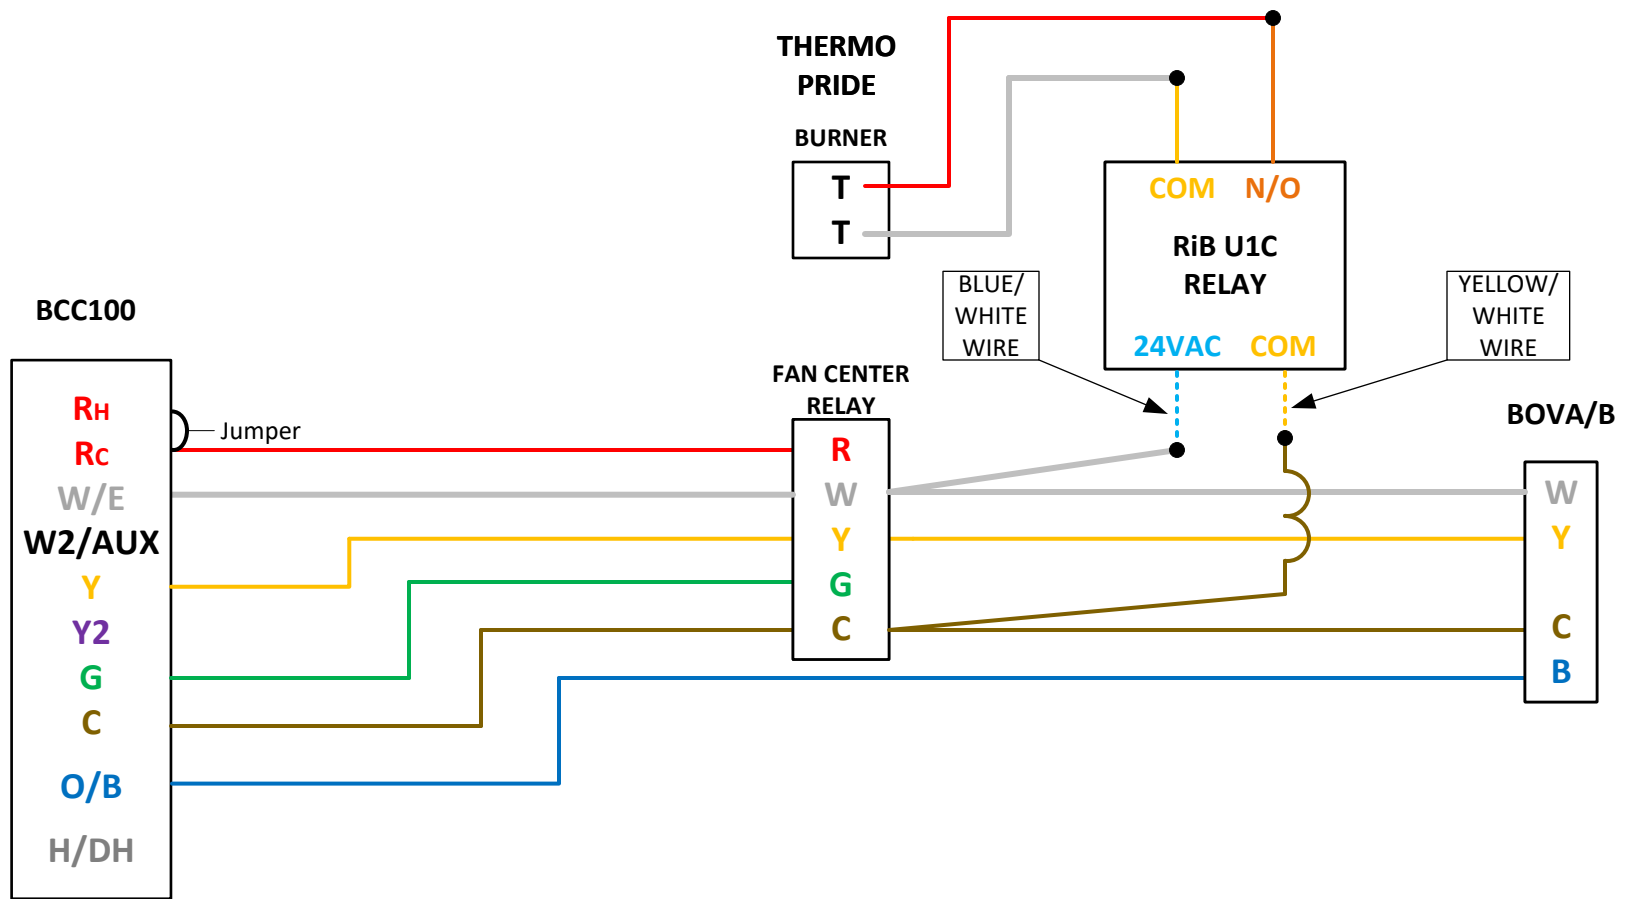

NOTES:
 For Oil or Power Gas Thermo Pride Furnaces with Fan Center Relay:
FAN – NEUT (120VAC) terminals on Control Board for Humidifier (field install
 24VAC transformer as needed)
EAC – NEUT (120VAC) terminals on Control Board for Electronic Air Cleaner (field install
 24VAC transformer as needed)

TSS Associates, Inc.	
DESCRIPTION BCC100 - Thermo Pride - BOVA/B	
DATE: 12/7/2022	PAGE: 1 of 2

PARAMETERS:

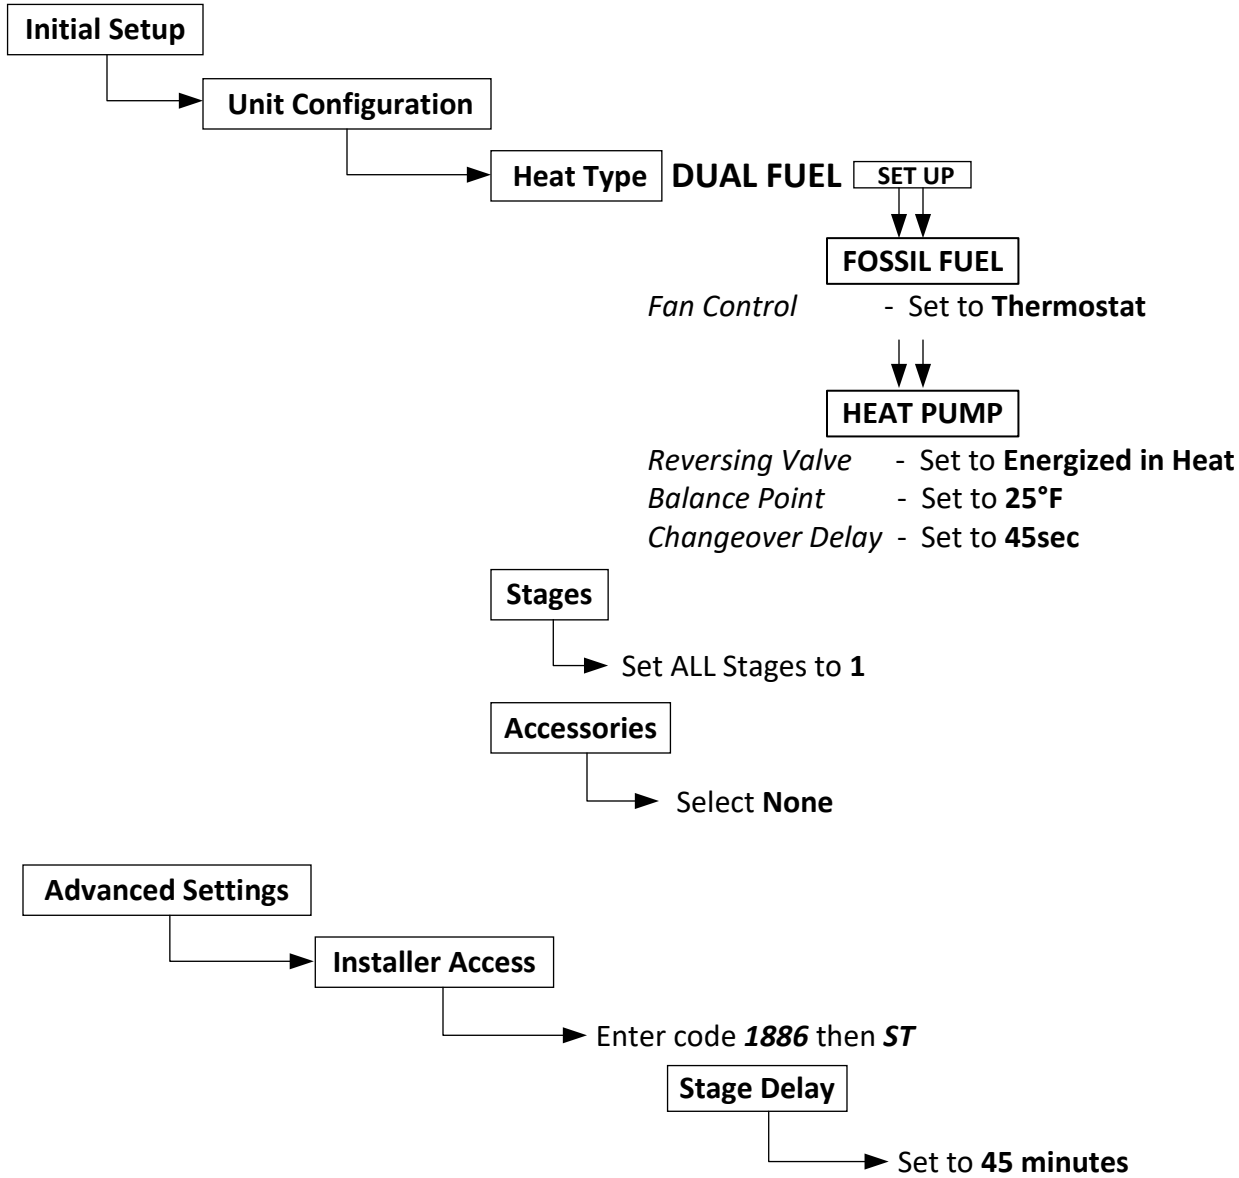

NOTES:

TSS Associates, Inc.

DESCRIPTION

BCC100 - Thermo Pride - BOVA/B

DATE: 12/7/2022

PAGE: 2 of 2