



# TSS Associates, Inc.




For further assistance, please contact  
Ecobee directly for Tech Support

---

1-877-932-6233

**\*\*IF WIRING MULTIPLE DAMPERS IN SERIES ON ONE ZONE, USE A DEDICATED TRANSFORMER AND ISOLATION RELAY AT EACH ZONE**

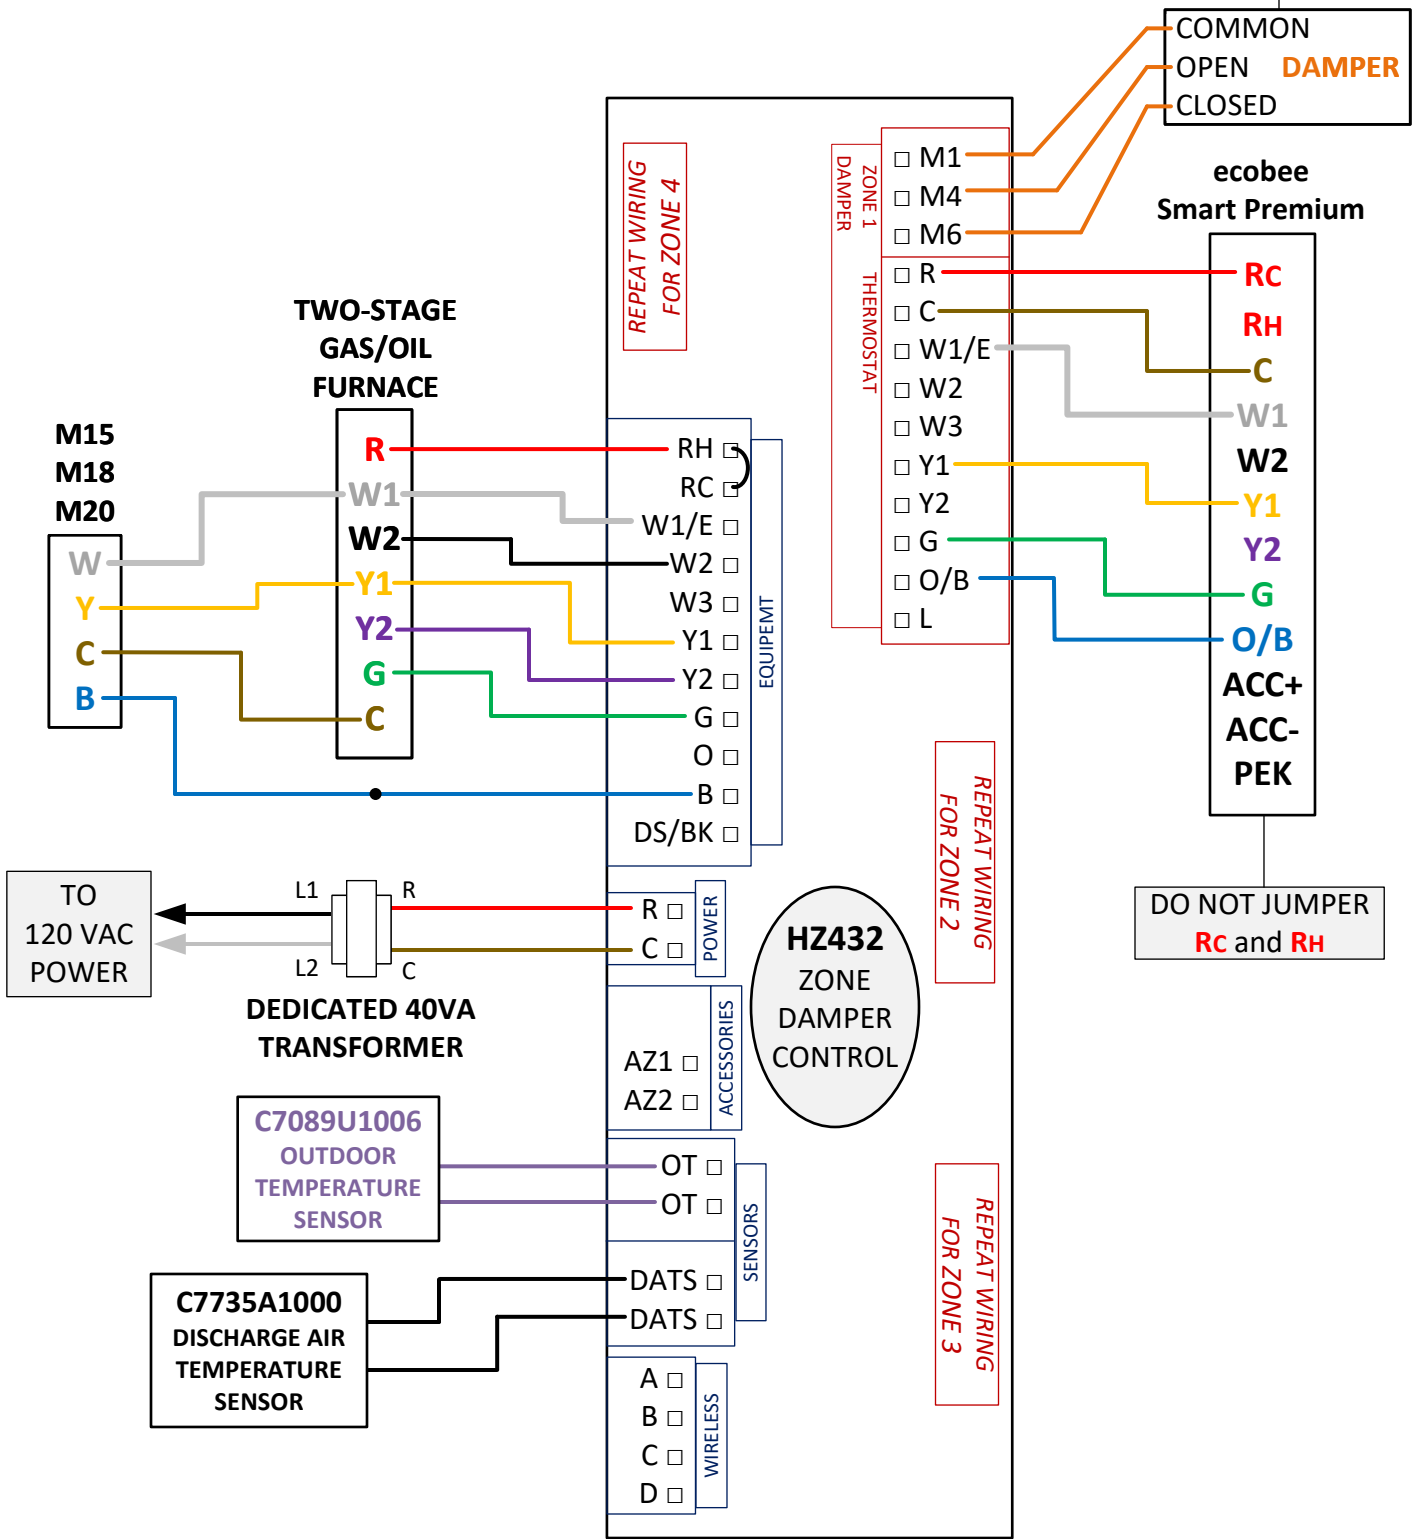

NOTES:

TSS Associates, Inc.

DESCRIPTION

ECOBEE SMART – BOSCH IDS – GAS/OIL FURNACE – HONEYWELL HZ432

DATE: 11/27/2023

PAGE: 2 of 3

**PARAMETERS:**

- >> Transformer > **YES, ONLY Rc IS CONNECTED**
- >> Configuration > Make sure highlighted icons correspond with wires installed
- >> Equipment > **HEAT PUMP > AIR TO AIR**
- >> O/B Reversing Valve > **ON HEAT**
- >> Allow Heat Pump and Aux Heat to run simultaneously > **DISABLE**
- >> Compressor Minimum Outdoor Temperature > **OFF**
- >> Type of heating > **FURNACE**
- >> How do you want your fan to be controlled > **BY THERMOSTAT**

↳ **MAIN MENU > SETTINGS > INSTALLATION SETTINGS (ADVANCED OPTIONS) > THRESHOLDS:**

- >> Threshold Staging > **AUTOMATIC** (factory default, adjust if receiving many "Aux heat running" alerts)
- >> Aux Savings Optimization > **MAXIMUM (2°F DROOP)**
- >> Auto Heat/Cool > **DISABLE**

**ZONE CONTROL PARAMETERS:**

- SYSTEM TYPE: **[HEATPUMP]**  
DUAL FUEL OPER: **[YES]**  
COMPRESSOR STAGES: **[2]**  
AUX HT ENABLED: **[NO]**  
DFUEL HT STAGES: **[2]**  
RF ENABLED: **[NO]** *\*\*THIS OPTION IS ONLY USED IF YOU ARE INSTALLING WIRELESS CONTROLLERS\*\**  
ZONES INSTALLED: **SELECT APPROPRIATE NUMBER OF ZONES BEING USED**  
ZONE1 TSTAT TYPE: **[HTPUMP-B]** → REPEAT THIS SELECTION FOR EACH ZONE  
STAGE 2 CONTROL: **[% ZONES]**  
STAGE 3 CONTROL: **[TIMER]**  
ADVANCED CONFIG? **[YES]** → HEAT FAN CONTROL: **[HVAC]**  
STAGE 3 TIMER: **[60]**  
DISCHARGE SENSOR: **[YES]**  
DAT HIGH LIMIT: **[145]**  
OT SENSOR: **[YES]**  
MSTG OT LOCKOUT: **[YES]**  
OT BALANCE TEMP: **[WHATEVER TEMPERATURE IS DESIRED]**  
  
SAVE CHANGES? **[YES]**

NOTES:

**TSS Associates, Inc.**

DESCRIPTION

ECOBEE SMART – BOSCH **IDS** – GAS/OIL FURNACE – HONEYWELL HZ432

DATE: 1/2/2024

PAGE: 3 of 3