



# TSS Associates, Inc.


# Honeywell

For further assistance, please contact  
Honeywell directly for Tech Support

---

1-800-633-3991

© Copyright 2023 TSS Associates, Inc. All Rights Reserved. No part of this document may be modified or reproduced without consent from TSS Associates, Inc. This document is for informational purposes only. For additional assistance, please contact Tech Support.

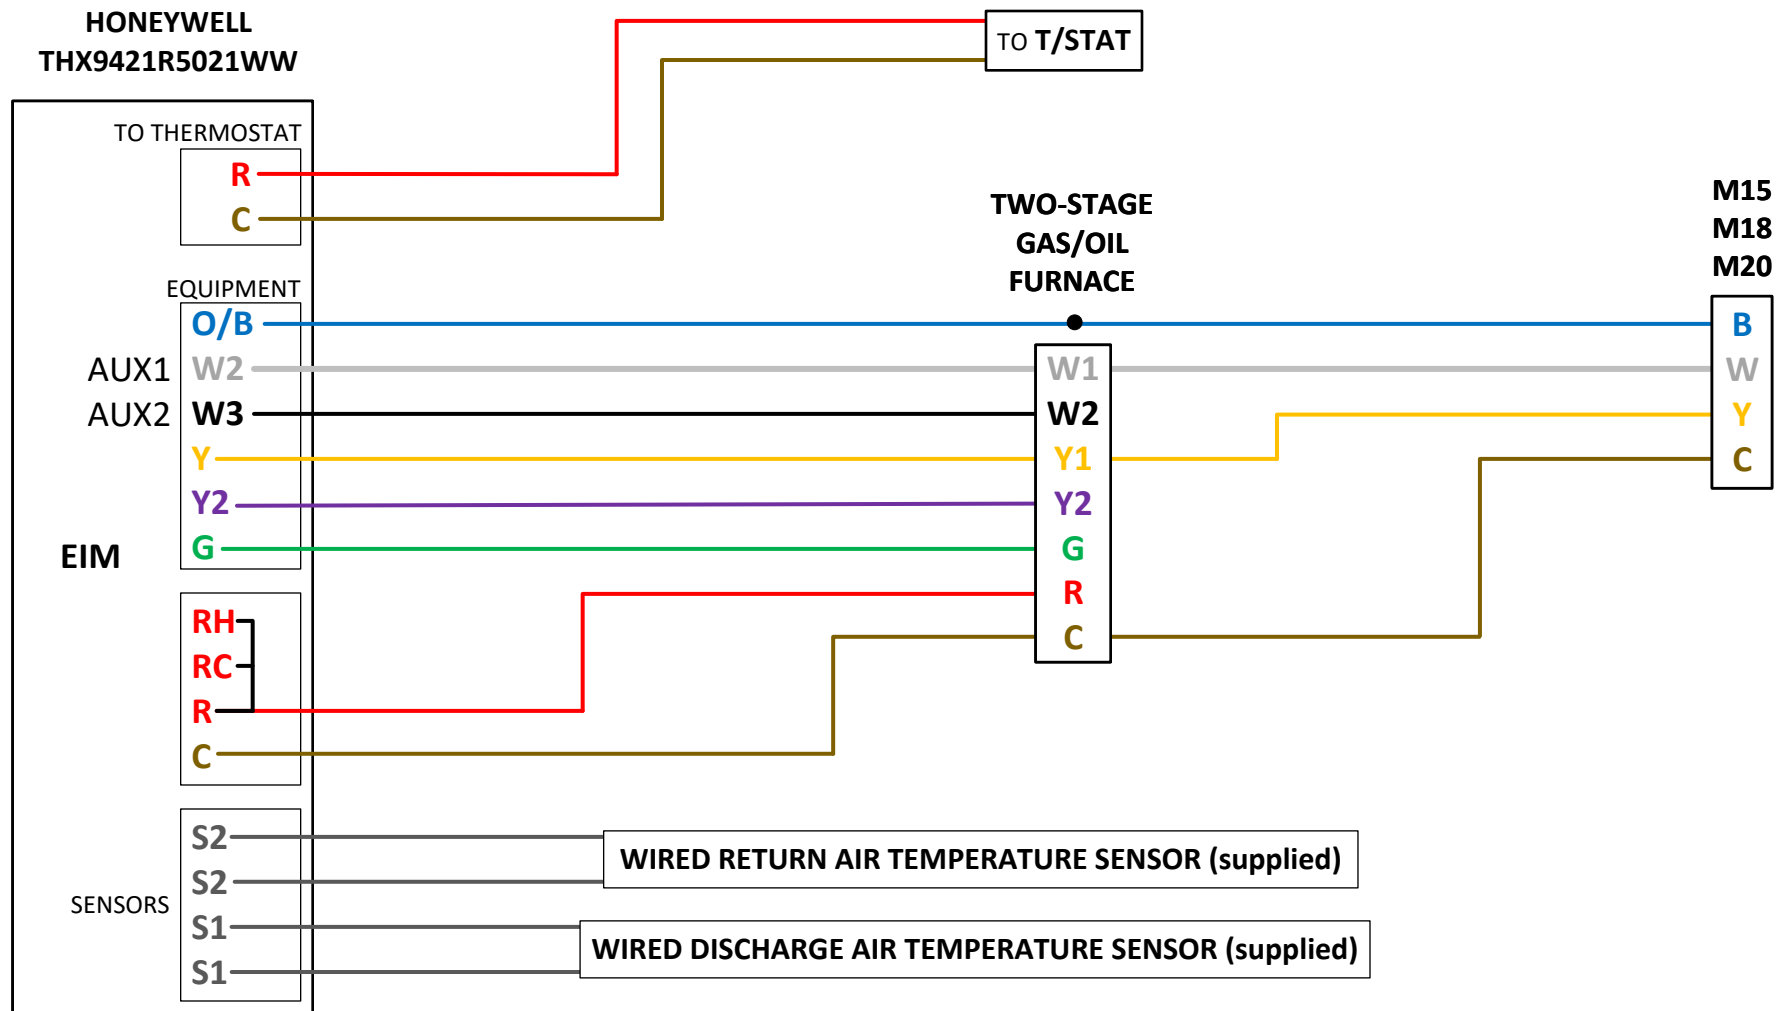

NOTES:

**\*\*If not using the supplied wireless outdoor sensor, part number C7089U1006 Wired Outdoor Sensor is required. Wire into S3 terminals.\*\***

**TSS Associates, Inc.**

DESCRIPTION  
**HONEYWELL T9 PRESTIGE – BOSCH IDS – TWO-STAGE FURNACE**

**PARAMETERS:**

- 1010 - Application - Set to **Residential**
- 1040 - Scheduling Options - Set to **Non-Programmable**
- 1060 - Outdoor Air Sensor - **Yes** (default when sensor is connected)
- 2000 - Heating System Type - Set to **Heat Pump**
- 2010 - Heating Equipment Type - Set to **Air-to-Air**
- 2060 - Reversing Valve O/B - Set to **B (O/B on Heat)**
- 2070 - Compressor Stages - Set to **2**
- 2130 - Backup Heat Stages - Set to **2**
- 2180 - Backup Heat Type - Set to **High Efficiency Gas Forced Air**
- 3000 - Changeover - **Manual**
- 3010 - Temperature Control Options - Set to **Advanced**
- 3080 - Backup Heat Differential (Droop) - Set to **2°F**
- 3110 - Backup Heat Upstage Timer - Set to **60 minutes**
- 3120 - Compressor Lockout/  
Balance Point - Set to **Whatever temperature is desired based upon homeowner comfort and energy costs**
- Backup Heat Lockout - Set to **Whatever temperature is desired based upon energy costs**
- 3140 - Compressor Cycles Per Hour (CPH) - Set to **1**
- 3160 - Heat Backup Cycles Per Hour (CPH) - Set to **1**
- 4090 - Adaptive Intelligence Recovery - Set to **Yes**

= Make sure to save changes at the end of the menu =

*\*\*All other setpoints should be left to Factory Settings unless any optional equipment has been added to system or based upon customer preference\*\**

NOTES:	<b>TSS Associates, Inc.</b>		
	DESCRIPTION HONEYWELL T9 PRESTIGE – BOSCH <b>IDS</b> – TWO-STAGE FURNACE		
	DATE:	1/8/2024	PAGE: 3 of 3